

Technical Service Bulletin:

Recommended Service Clearances

Models: All Models



BOSCH

Introduction

The following schematics show the recommended service clearance for all Water Source Heat Pump units.




Local or National electric codes may require 36" or more clearance at all electrical control boxes.




Repair or replacement of the water coil may require removal of the unit.


Horizontal Units - Sizes 007 thru 070

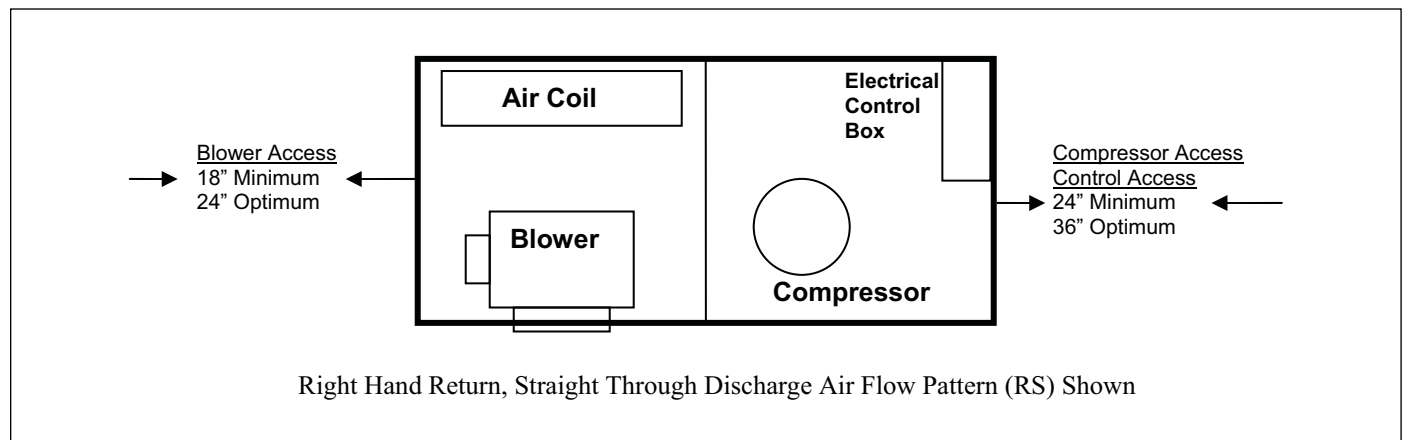


Horizontal Units - Sizes 072 thru 150

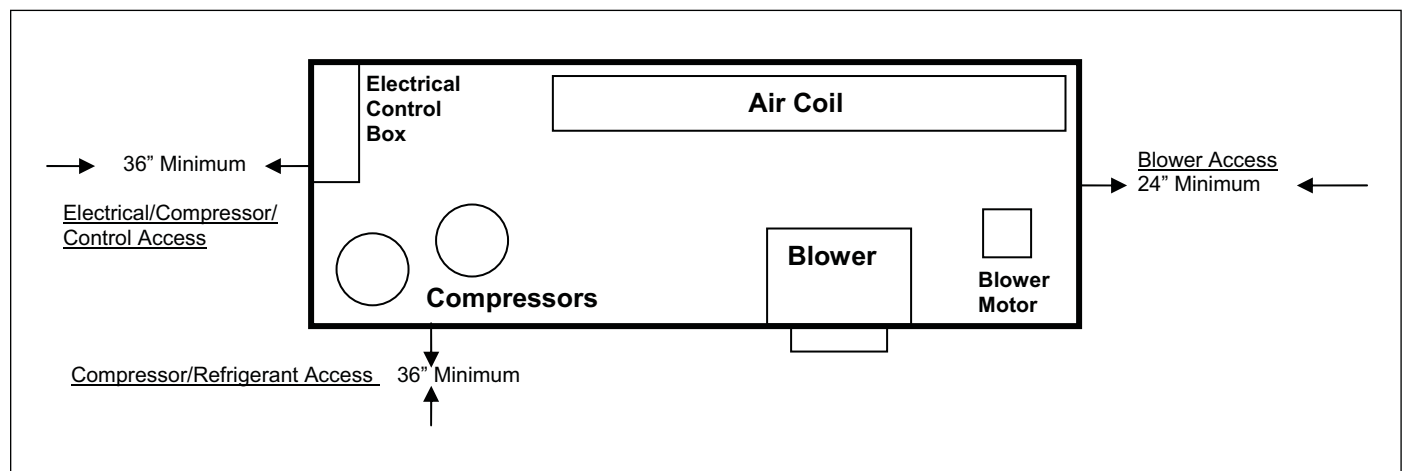


Horizontal Units - Sizes 180 thru 242

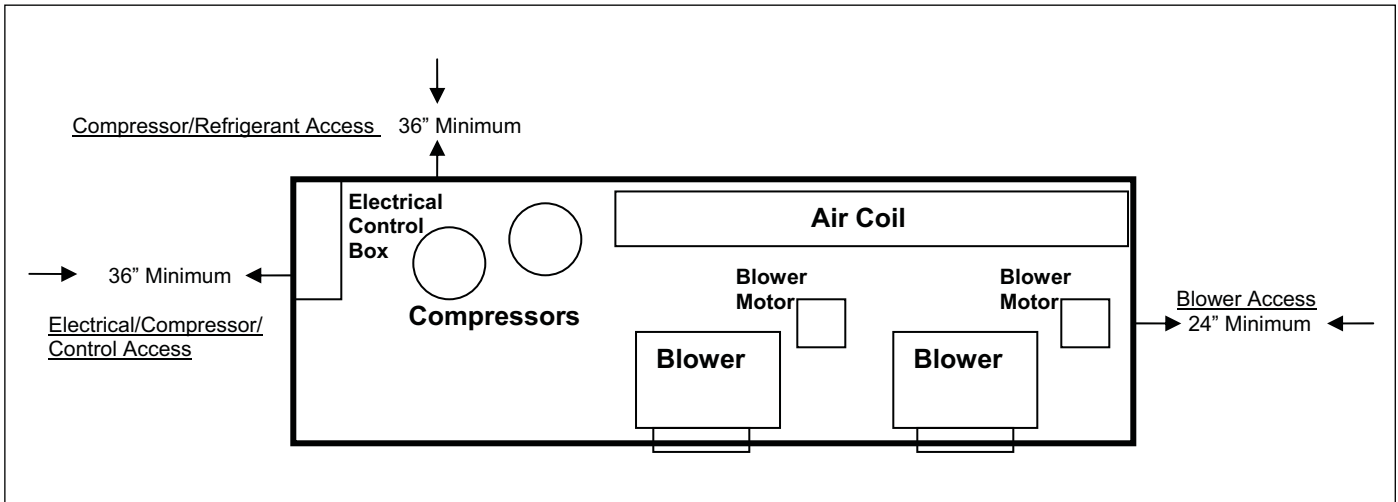

Vertical Units - Sizes 007 thru 070

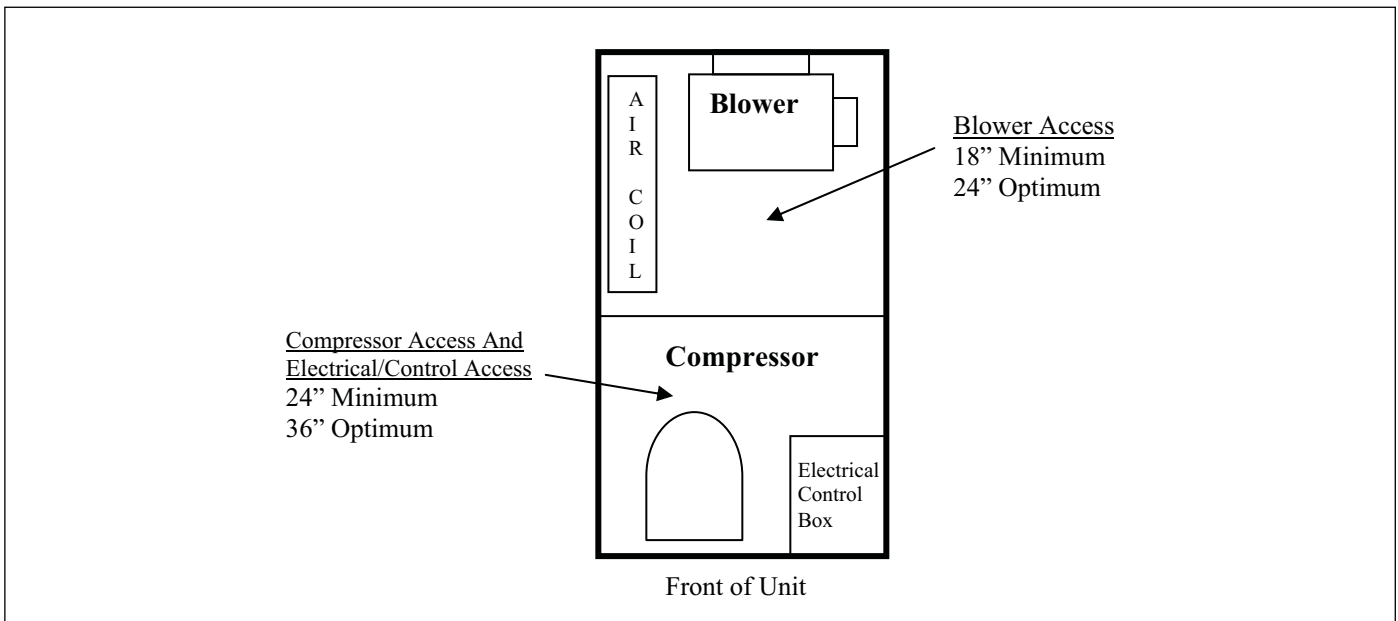


Vertical Units - Sizes 072 thru 181

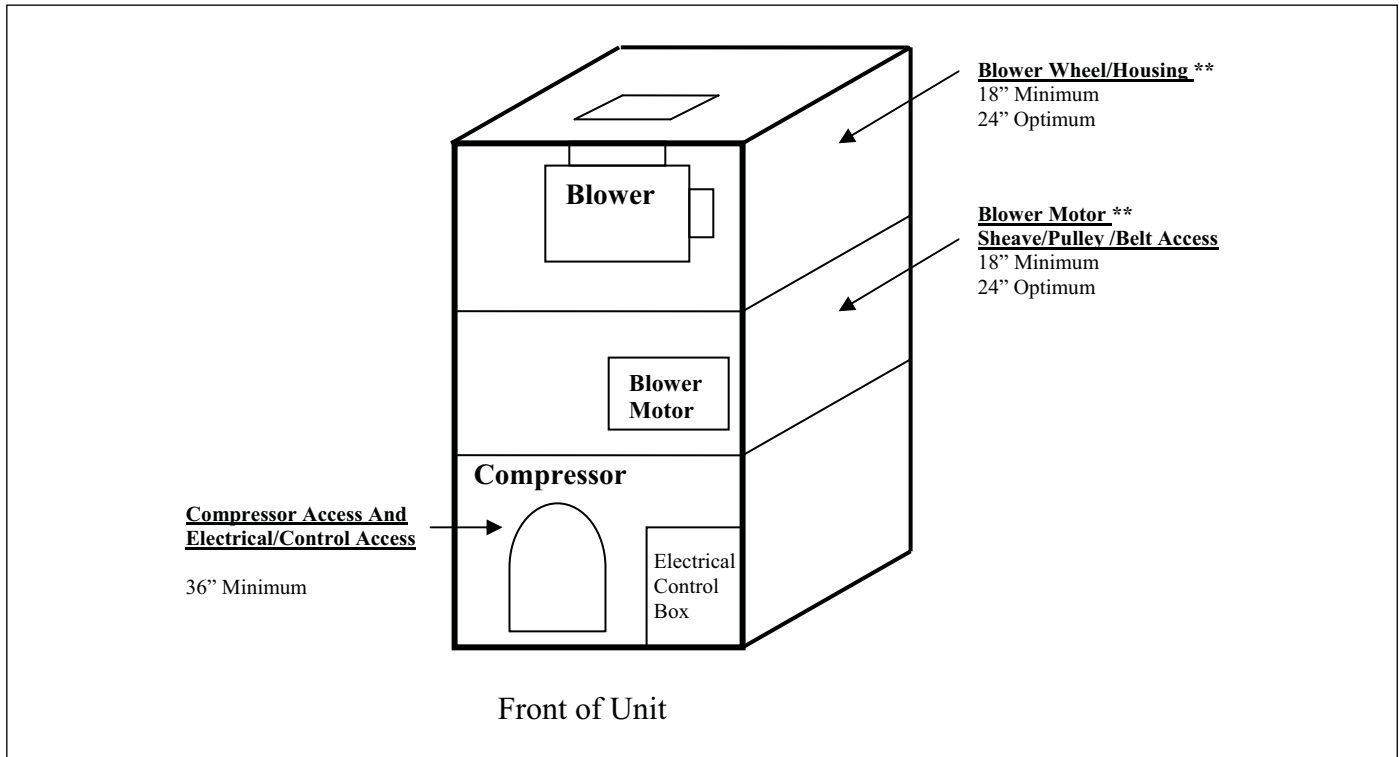


** Rear Return Air Pattern shown. For Front Return Air, blower motor and blower housing access is on the LEFT HAND SIDE of the unit

Vertical Units - Sizes 210 thru 360

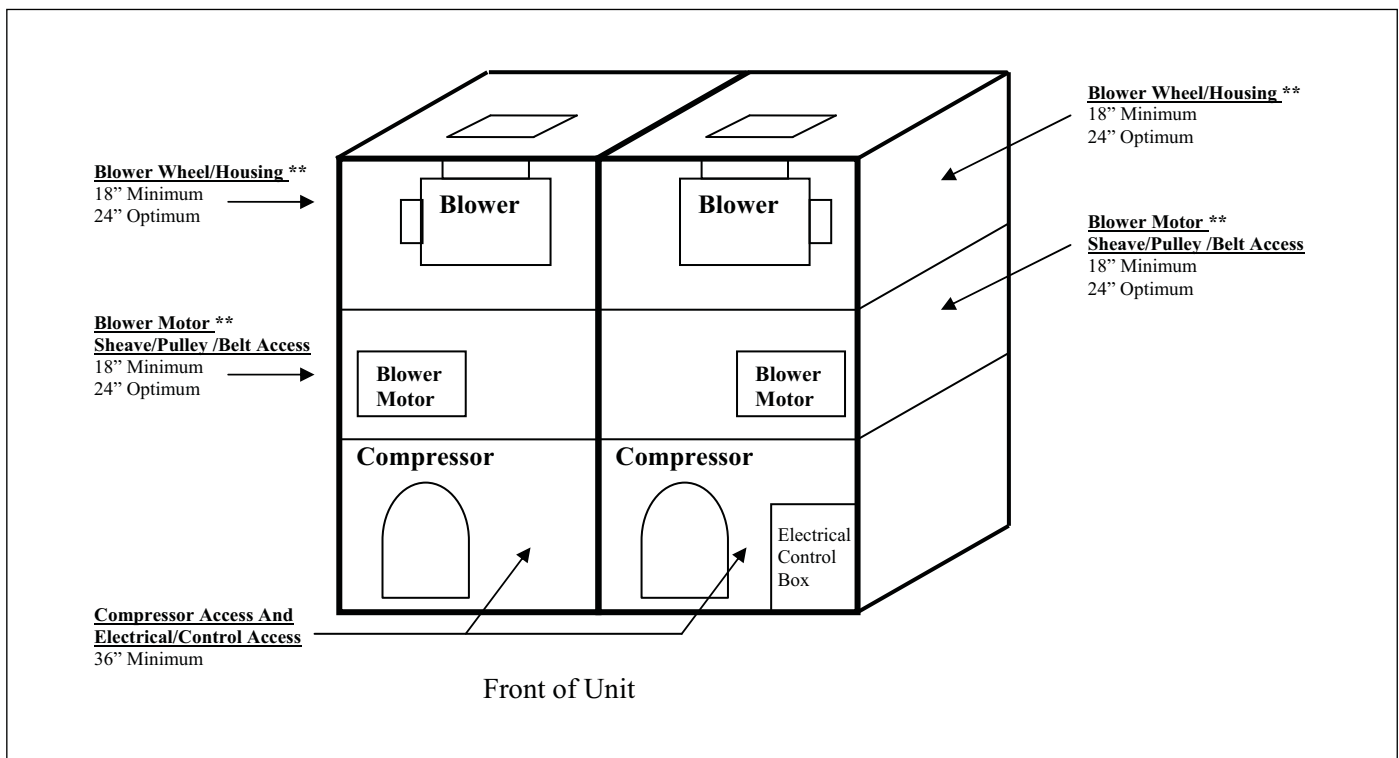


** Blower motor and Blower housing access is required on BOTH SIDES of the unit


Water-to-Water Units: Sizes 024 thru 072

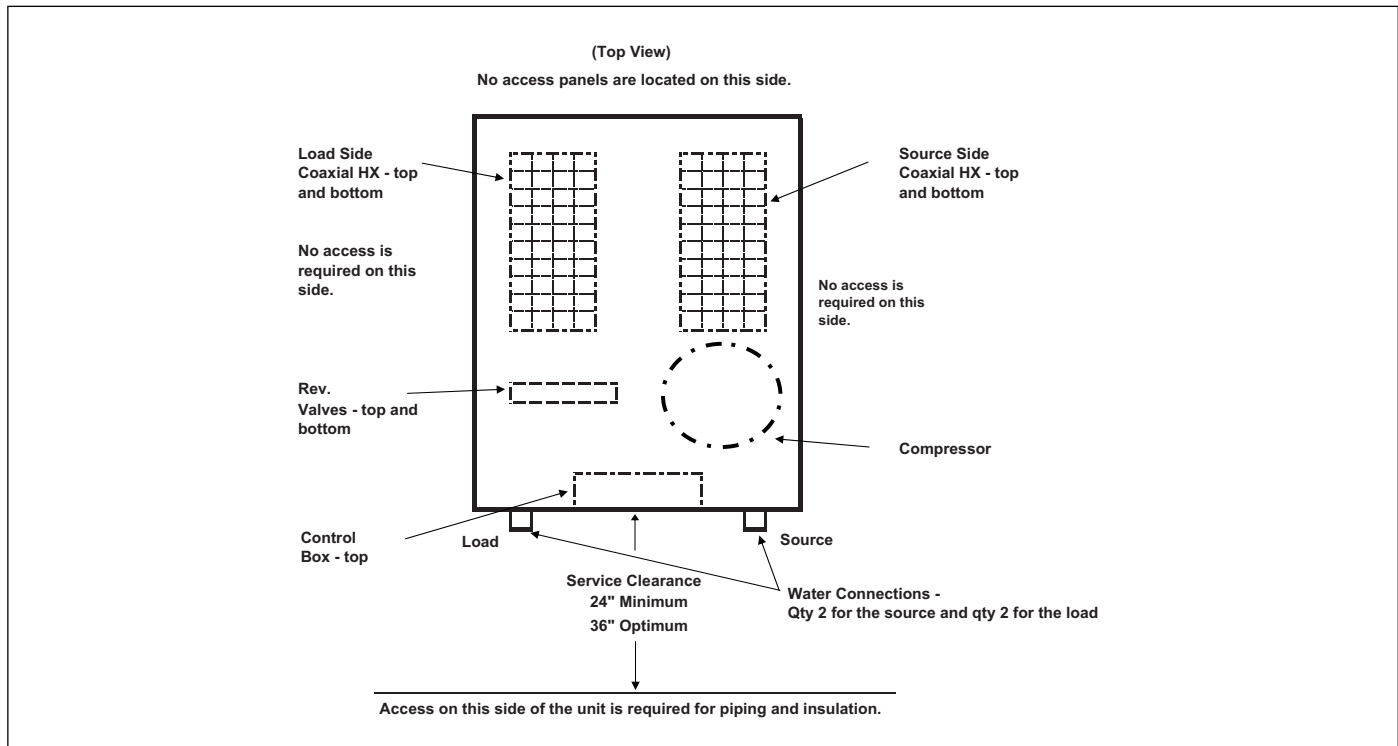

Water-to-Water Units: Sizes 120 thru 210

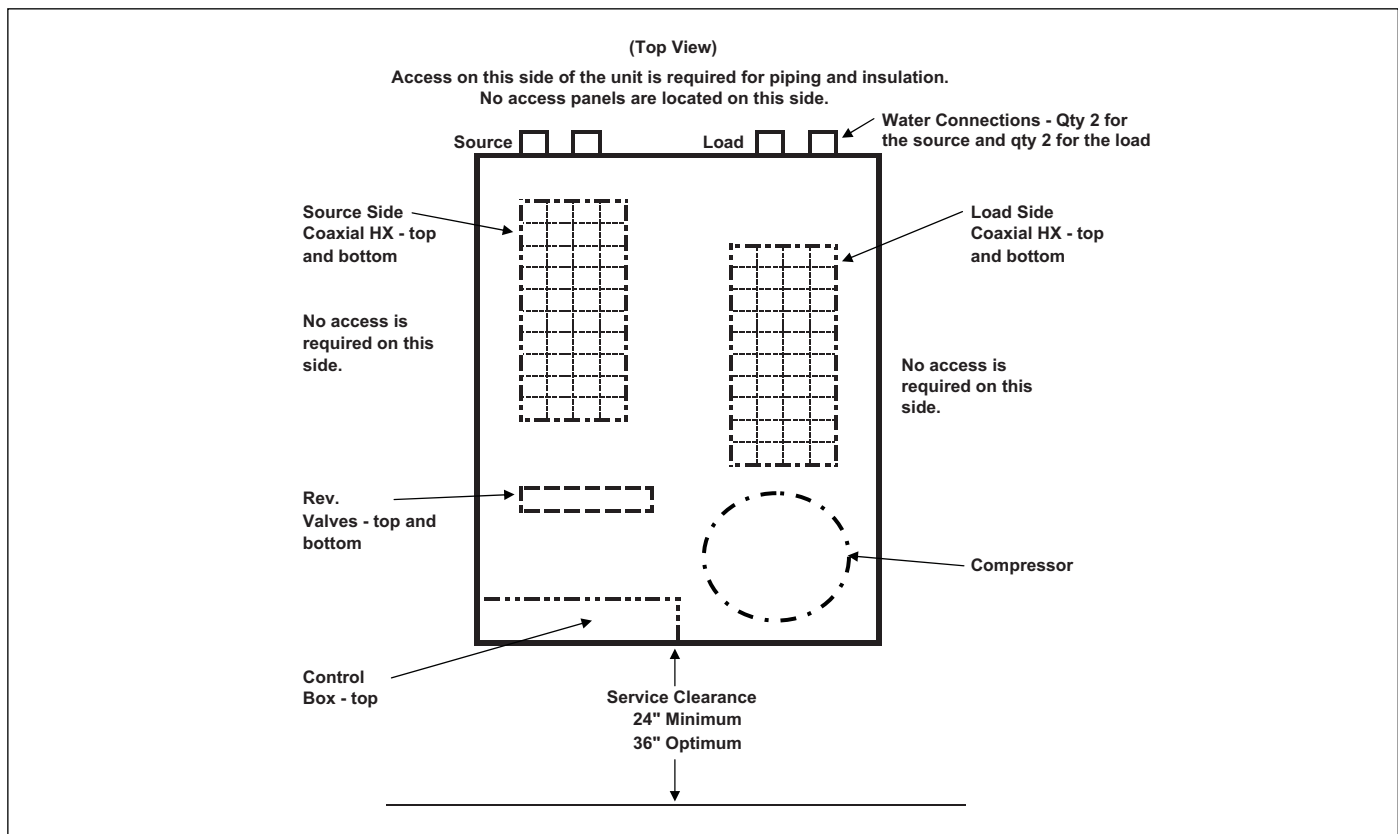

Water-to-Water Units: Sizes 240 thru 420

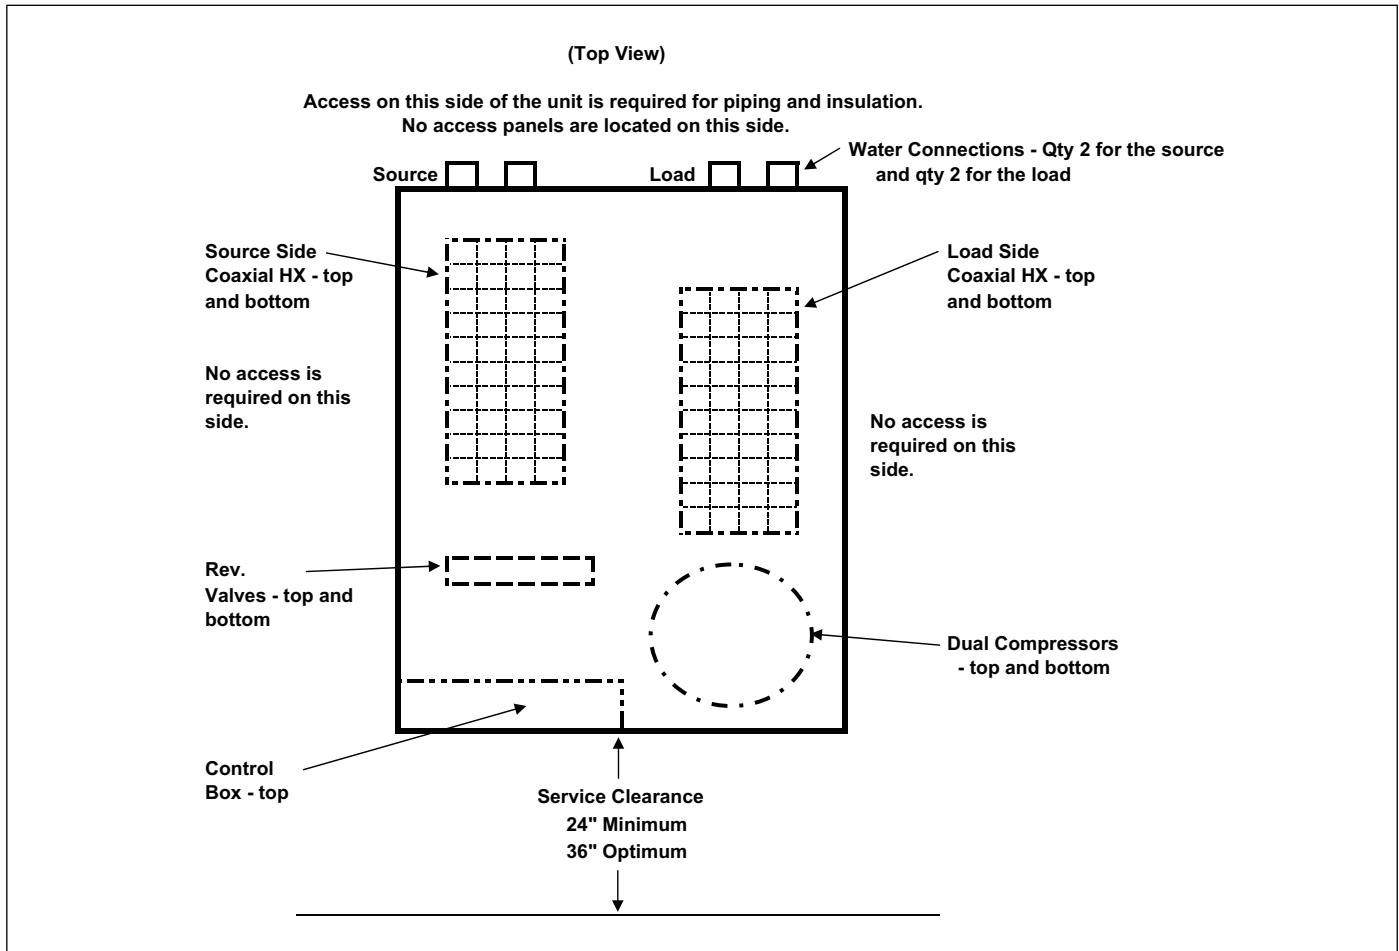

Bosch Thermotechnology Corp.
50 Wentworth Avenue
Londonderry, NH 03053

Tel: 1-866-305-9974
Fax: 1-954-776-5529
www.boschheatingandcooling.com